



BRICK RED  
TRUNCATED DOME  
DETECTABLE WARNINGS  
24" x 48"

TYPE A RAMPS

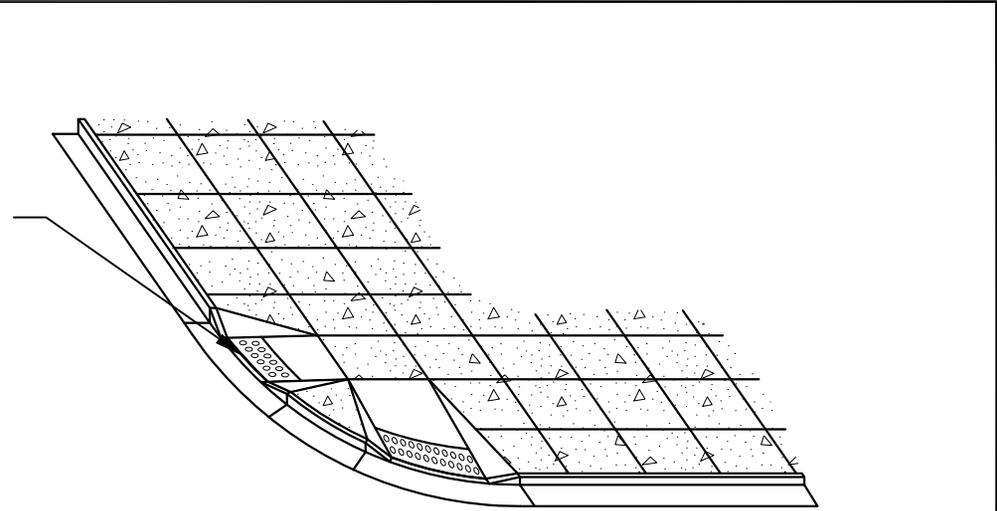

TYPE B RAMPS

**SIDEWALK RAMP**

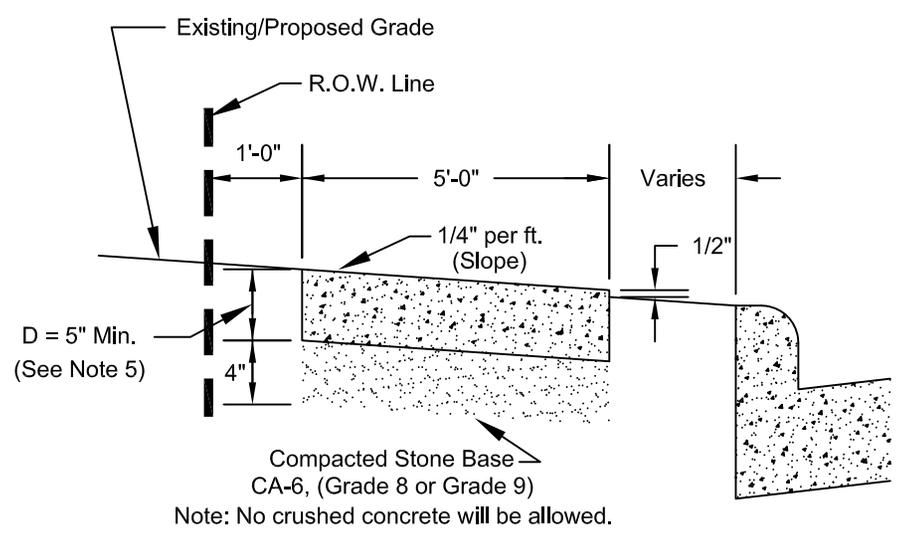


**PUBLIC SIDEWALK**


**NOTE:**

1. TO BE FORMED WITH 2" x 6" BOARDS OR BY 5" WIDE STEEL FORMS.
2. TOOLED JOINTS SHALL BE 1/2" AT 5' CENTERS.
3. EXPANSION JOINTS SHALL BE 3/4" THICK X 5" WIDE BITUMINOUS IMPREGNATED FIBERBOARD AT 30' CENTERS, AT DRIVEWAYS AND OTHER CONCRETE JOINTS.
4. PROVIDE BROOM FINISH EXCEPT AT TRUNCATED DOME.
5. D = MATCH THICKNESS WHEN CROSSING THROUGH DRIVEWAYS
6. SIDEWALK RAMPS AT DRIVEWAYS SHALL BE BUILT PER THE VILLAGE STANDARD.
7. THE COMPRESSIVE STRENGTH SHALL MEET OR EXCEED I.D.O.T.'S REQUIREMENTS FOR "SI" CONCRETE (MINIMUM 3500 PSI @ 14 DAYS)
8. PROVIDE DEPRESSED CURBS AT ALL WALKS, 4' MINIMUM WIDTH ON DEPRESSION.
9. ALL SIDEWALKS, CURB/GUTTER AND PAVEMENT TO BE SAW-CUT AS REQUIRED.
10. MAXIMUM SLOPE OF RAMP NOT TO EXCEED 8%.
11. DRIVEWAY APRON REMOVAL & REPLACEMENT SHALL INCLUDE THE INSTALLATION OF A TRUNCATED DOME HANDICAPPED SIDEWALK RAMP ON BOTH SIDES OF THE APRON UNLESS OTHERWISE APPROVED BY THE VILLAGE ENGINEER.
12. TRUNCATED DOME CONSTRUCTION FOR DETECTABLE WARNINGS SHALL BE ARMOR-TILE TACTILE SYSTEMS FEDERAL #22144 OR ARMORCAST WET SET PANEL, BRICK RED AND SHALL MEET THE REQUIREMENTS OF ALL APPLICABLE I.D.O.T. STANDARDS. NO SURFACE MOUNT PANELS ALLOWED.

VILLAGE OF BENSenville SPECIFICATIONS AND DETAILS		REVISIONS	
FILE LOCATION			
G:\ENGINEERING\STANDARDS\ NEW STANDARDS\ROADWAY			

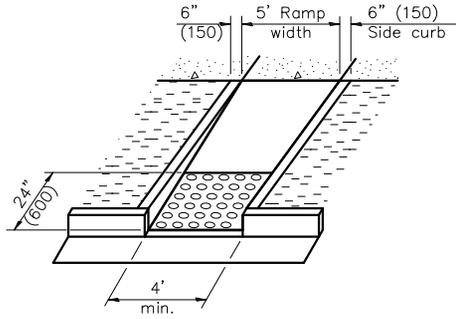


**TYPE A**

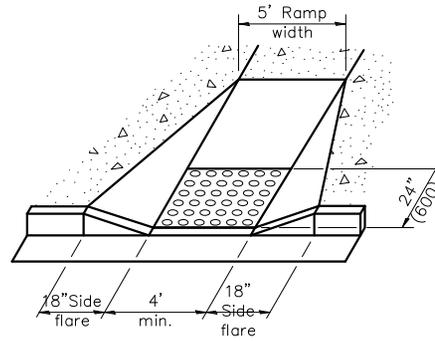


**TYPE B**

**RAMP DETAILS**

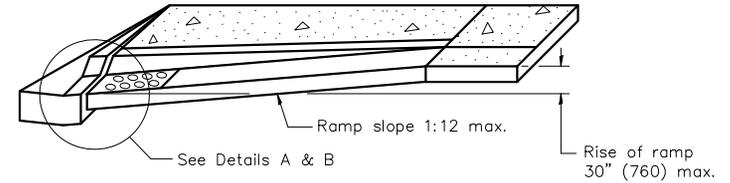

**RAMP PROFILE**

**RAMP PROFILE**

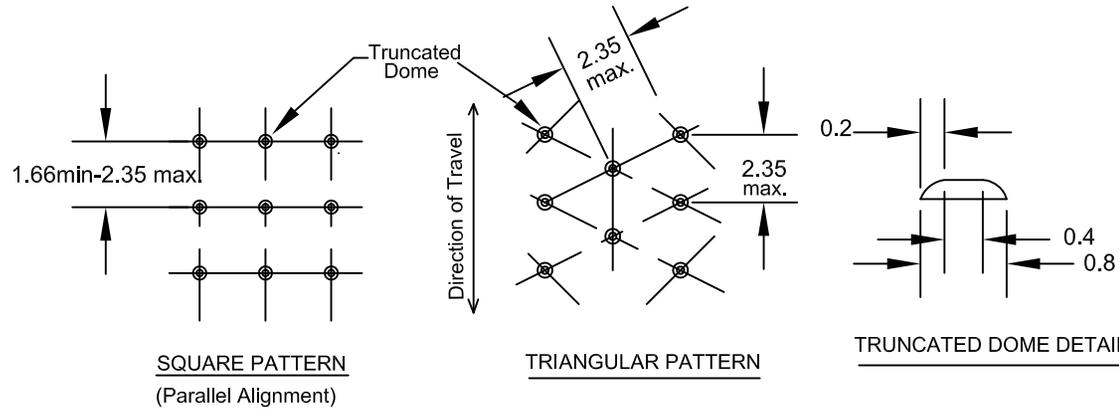

**DETECTABLE WARNINGS DETAIL**

All dimensions are in inches unless otherwise shown



VILLAGE OF BENSENVILLE  
12 S. CENTER STREET  
BENSENVILLE, IL 60106  
WWW.BENSENVILLE.IL.US

**PUBLIC SIDEWALK  
STANDARD**

(2 OF 2)

VILLAGE OF BENSENVILLE SPECIFICATIONS AND DETAILS		REVISIONS	
FILE LOCATION			
G:\ENGINEERING\STANDARDS\ NEW STANDARDS\ROADWAY			