DRAFT

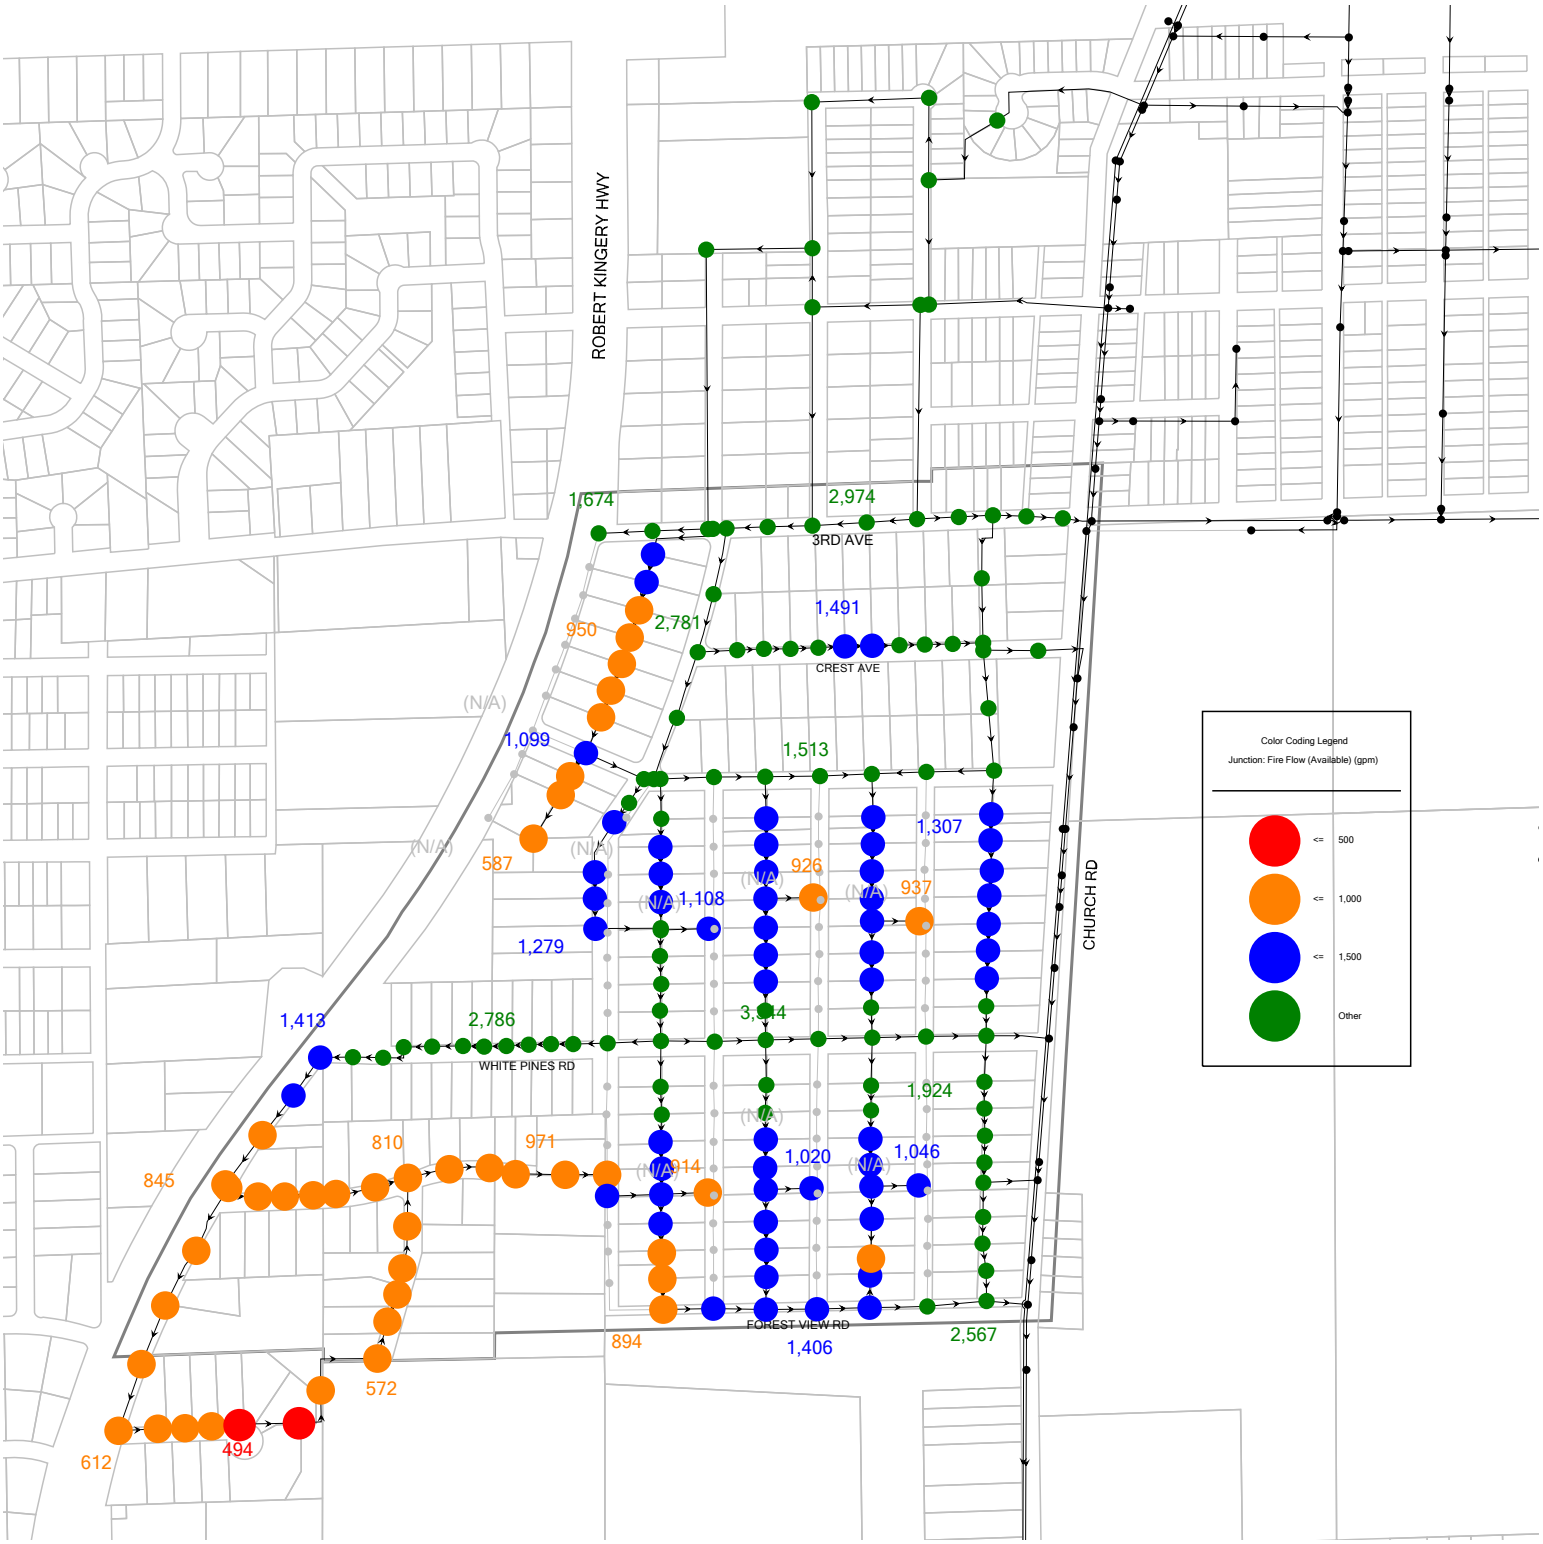

Village of Bensenville, IL
White Pines Water System Evaluation
October 2015

EXHIBIT 1

MAX Daily Demand

Available Fire Flows

Existing Conditions

DRAFT

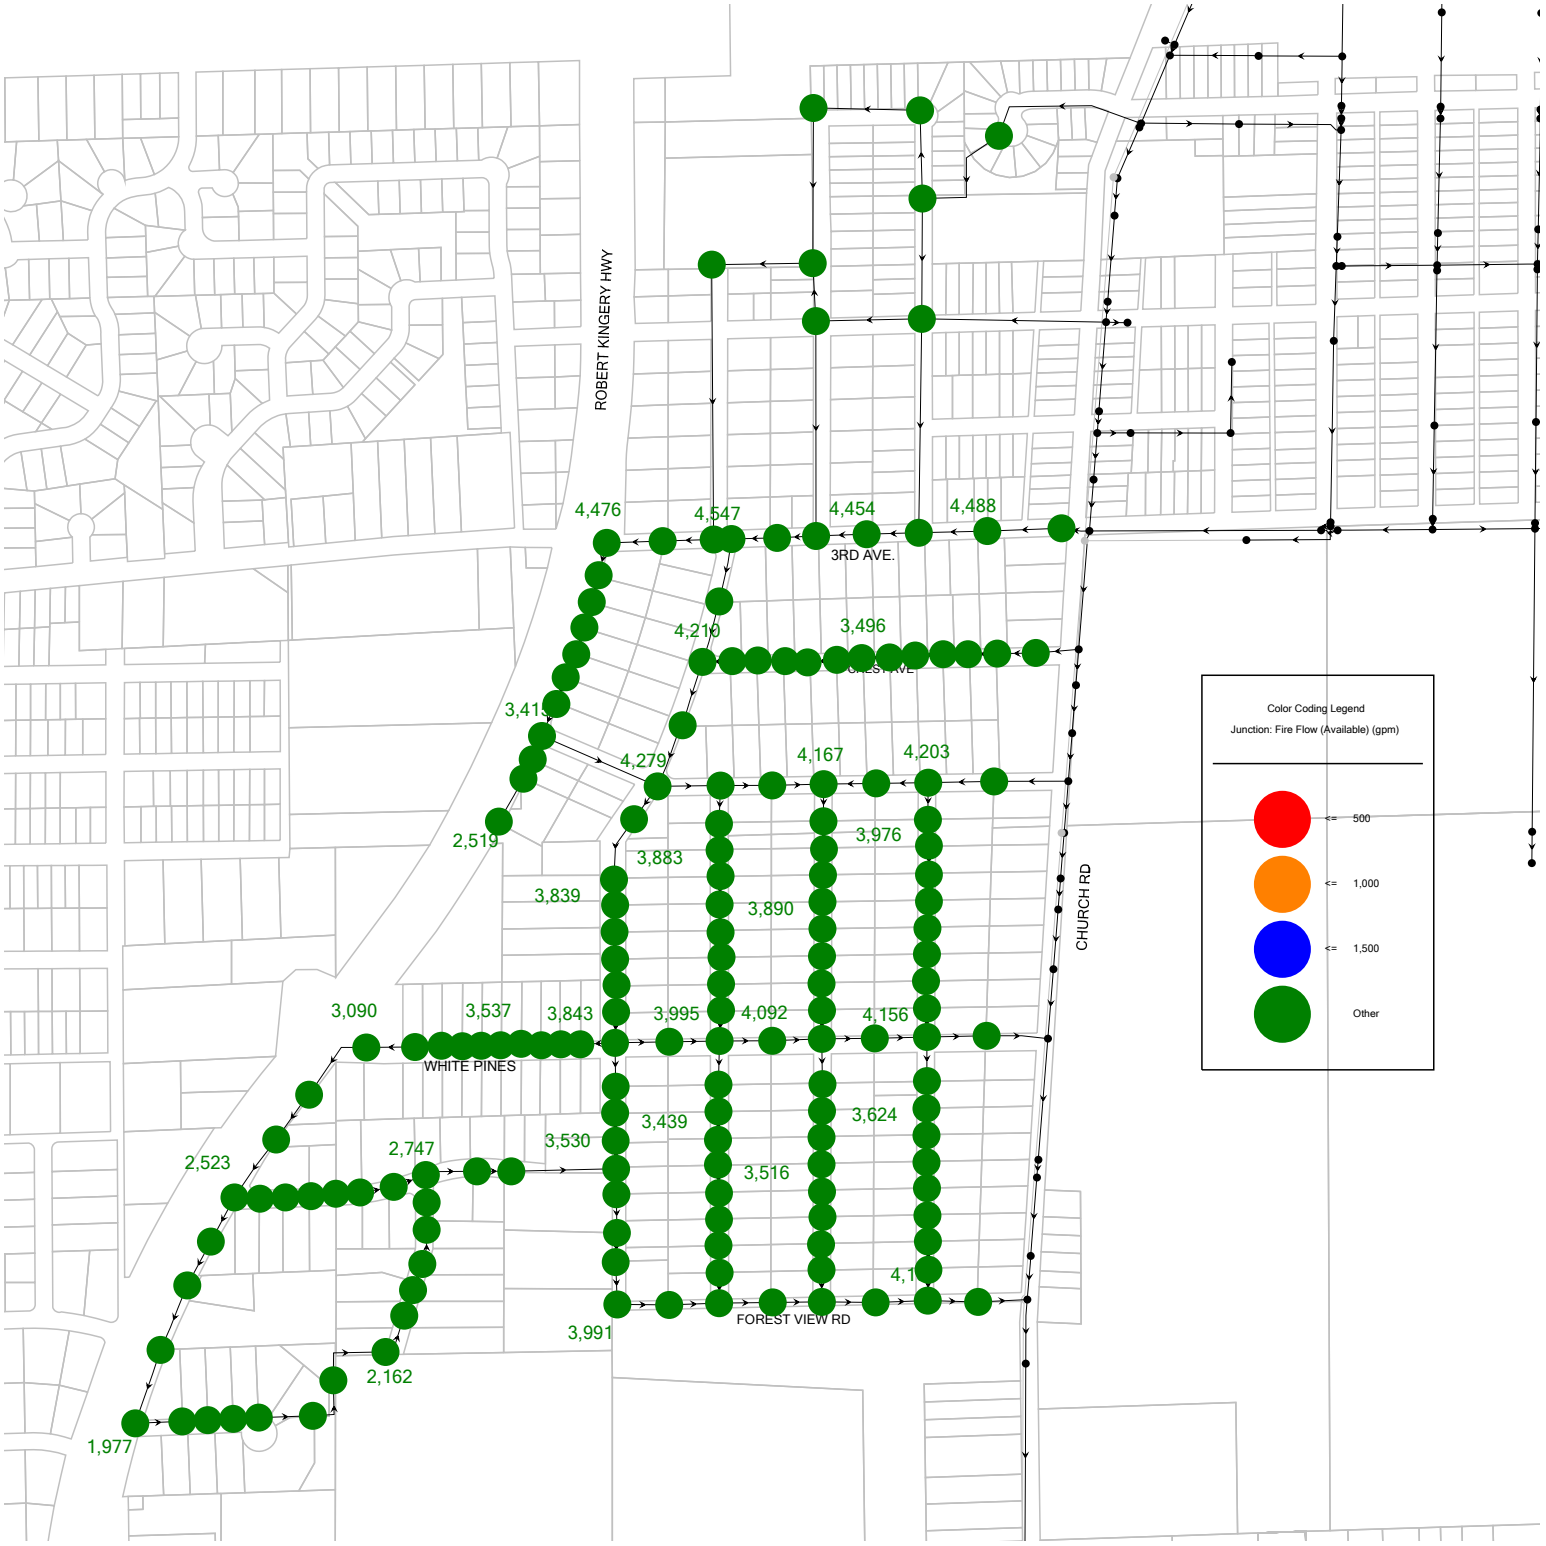

Village of Bensenville, IL
White Pines Water System Evaluation
October 2015

EXHIBIT 2

MAX Daily Demand

Available Fire Flows
(Option 1 - All Mains Replaced Except Briar & White Pines)

DRAFT

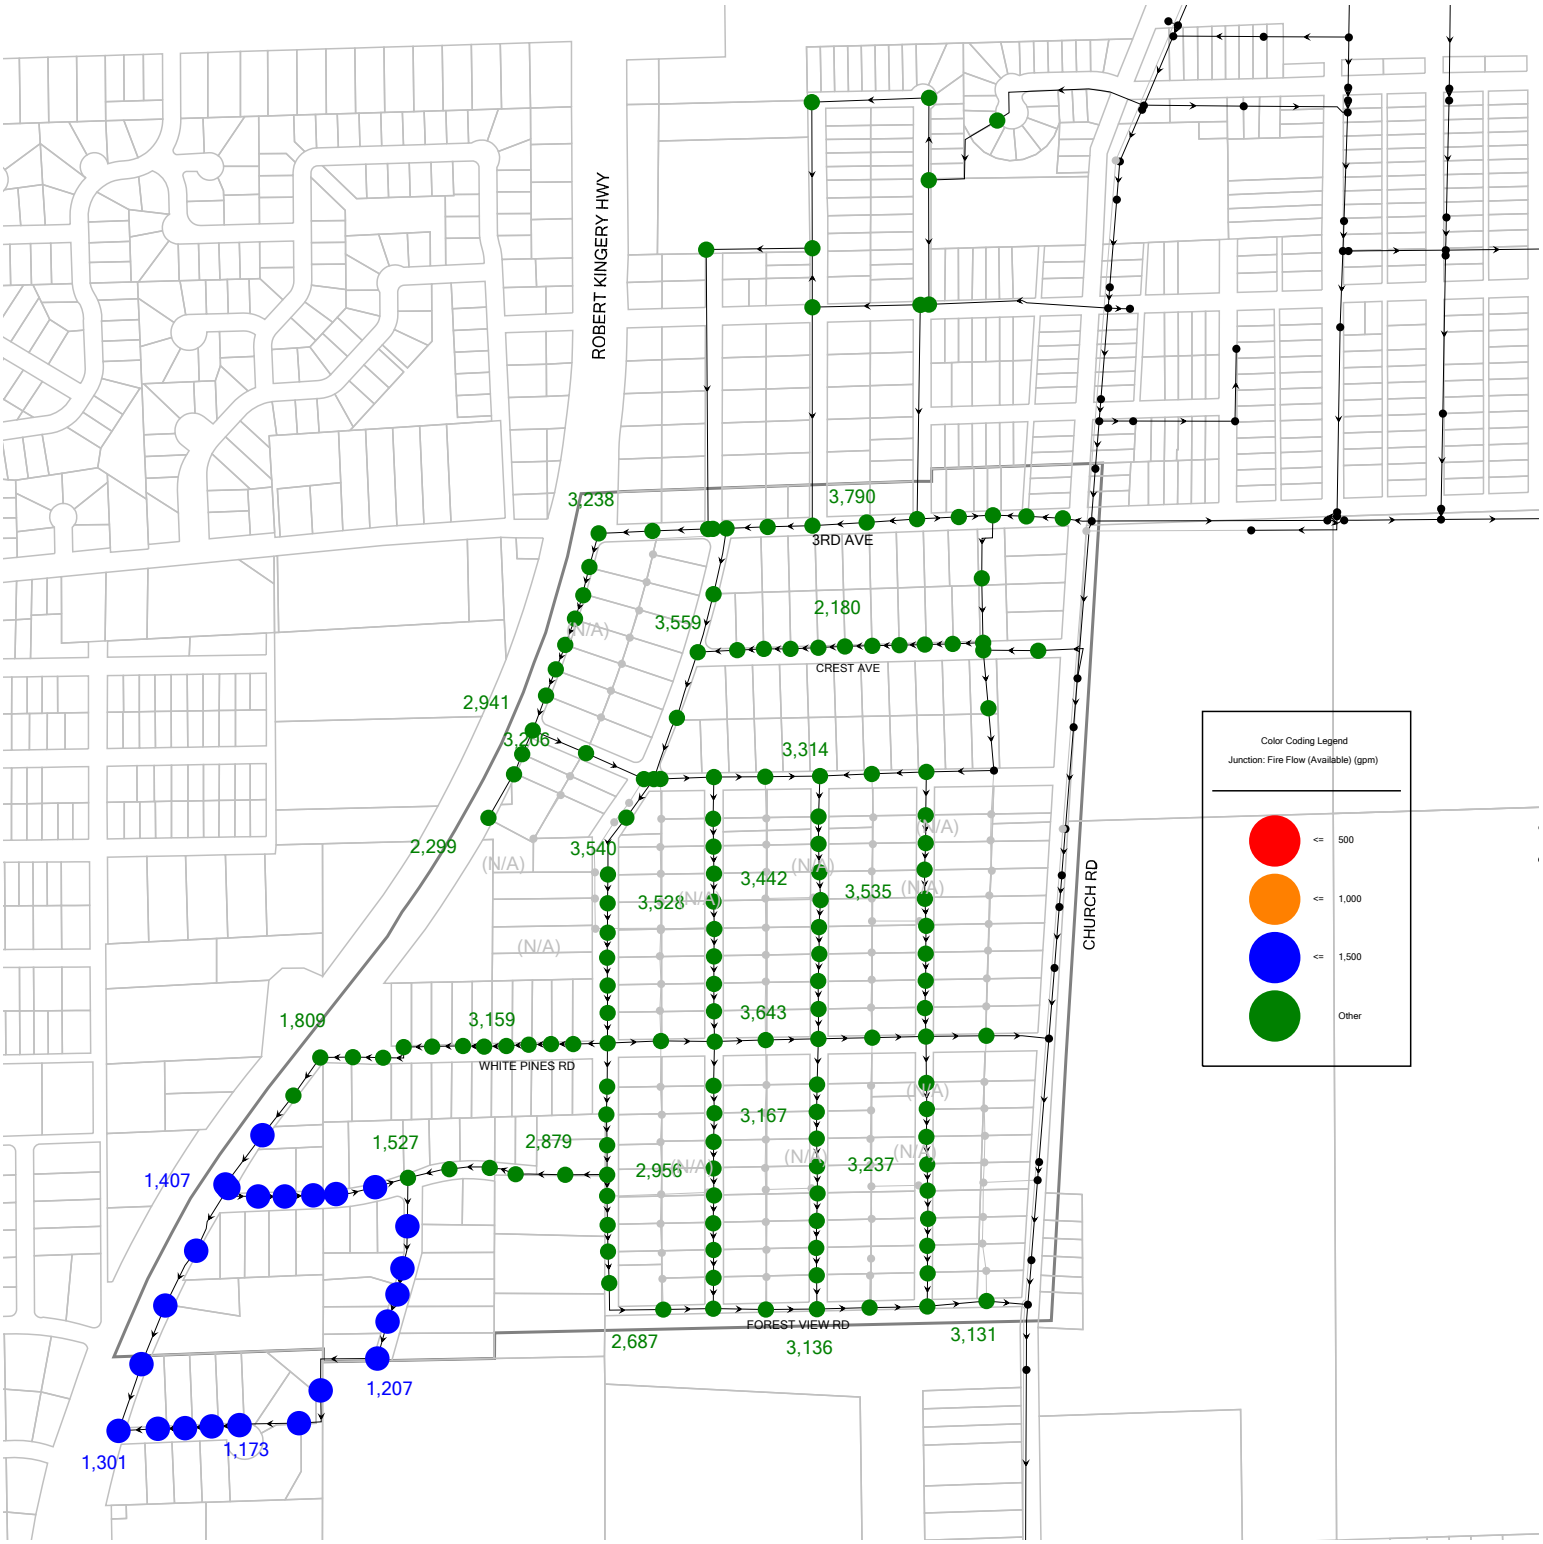

Village of Bensenville, IL
White Pines Water System Evaluation
October 2015

EXHIBIT 3

MAX Daily Demand

Available Fire Flows
(Option 2 – Backyard Mains Relocated to Roadway, Existing Roadway Mains Lined)

DRAFT

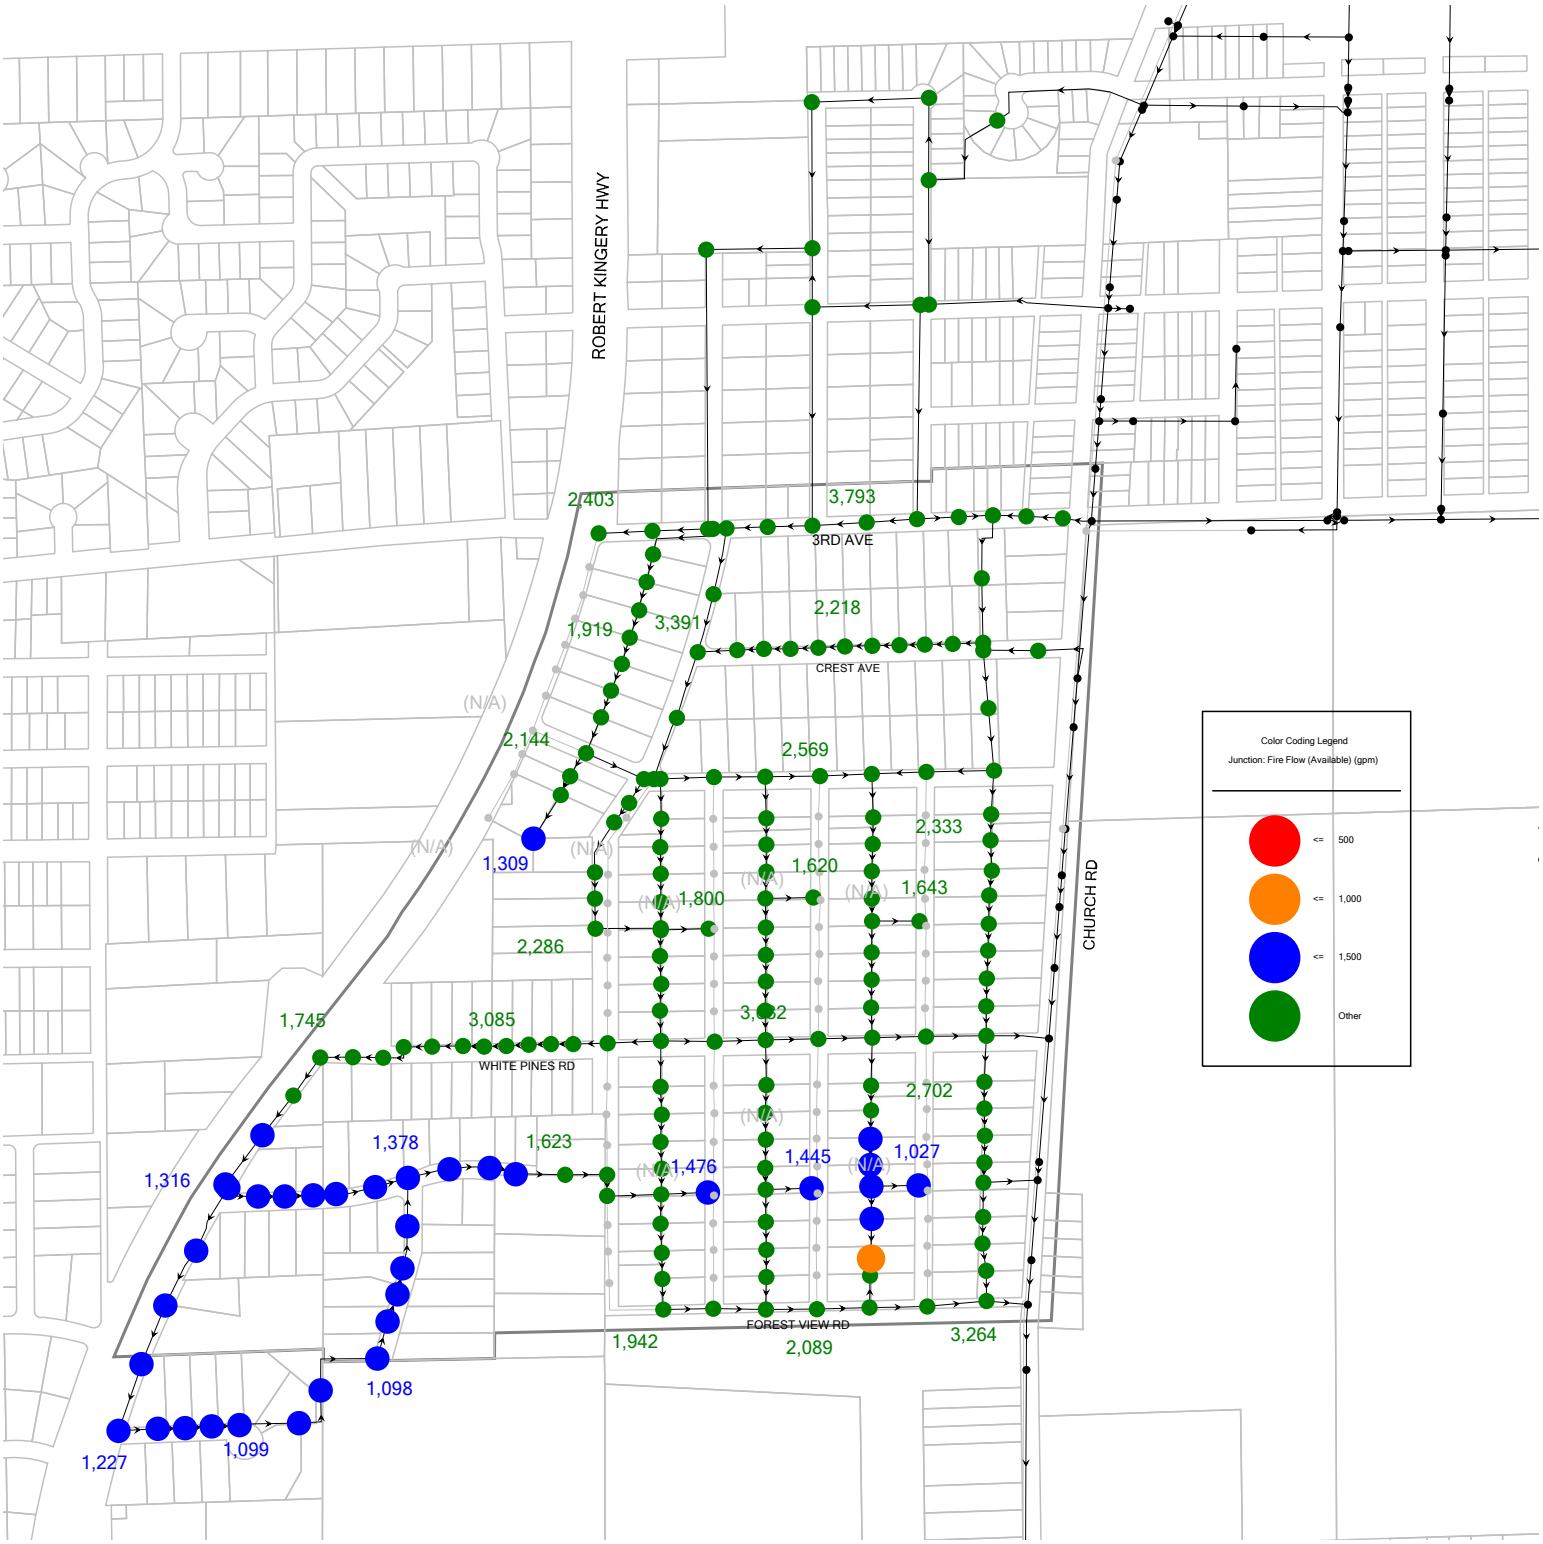

Village of Bensenville, IL
White Pines Water System Evaluation
October 2015

EXHIBIT 4

MAX Daily Demand

Available Fire Flows

(Option 3 – All Existing Mains Lined)

DRAFT

Village of Bensenville, IL
White Pines Water System Evaluation
October 2015

EXHIBIT 5

MAX Daily Demand

Available Fire Flows
(Option 4 - Backyard Mains Lined,
No Work on Roadway Mains)